4 - LIFTING INSERTS

¾" - 10 N.C. (3" MIN. LENGTH)

2 - ⅝" Ø BOLTS - 6" LONG (3" - 11 N.C.)

2 - ⅝" Ø BOLTS - 17" LONG (3" - 11 N.C.)

4 - ⅝" GALVANIZED WASHERS

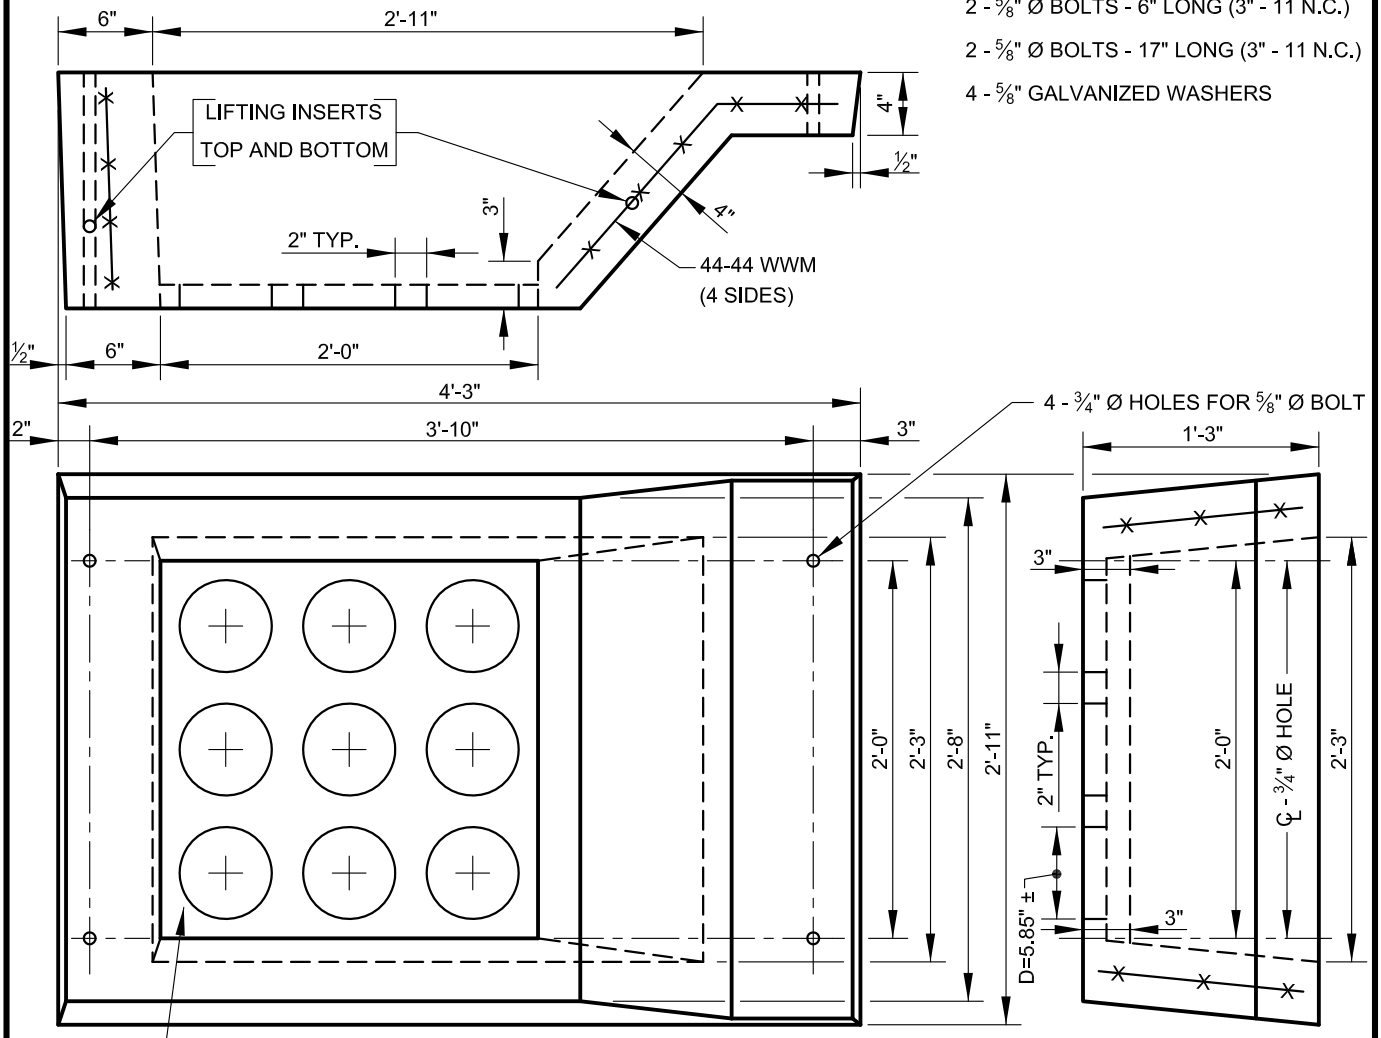

CAST 9-WAY PLASTIC TERMINATOR FOR 5" I.D. DUCT FLUSH WITH OUTSIDE FACE OF WALL

GENERAL NOTES

SPECIFICATIONS	LATEST DEPARTMENT OF GENERAL SERVICES
CONCRETE	MIX NO. 3
WELDED WIRE MESH	ASTM A185
COVER	1 ½" MINIMUM
PLASTIC TERMINATOR	TYPE AS APPROVED BY UTILITY ENGINEER
LIFTING DEVICES	TYPE AS APPROVED BY ENGINEER
BOLTS	BOLTS SHALL BE HOT DIPPED. GALVANIZED STEEL MEETING THE REQUIREMENTS OF ASTM A-307. GALVANIZING TO BE PER ASTM A-123. WASHERS TO BE COMPATIBLE.
MASTIC COMPOUND	PLACE ON MANHOLE WALL PRIOR TO ATTACHING RECESSED EXTENSION. MATERIAL SHALL MEET THE REQUIREMENTS SPECIFIED BY THE ENGINEER.

APPROVED:

CHIEF, CONDUIT DIVISION

DIRECTOR, DEPARTMENT OF TRANSPORTATION

CITY OF BALTIMORE
DEPARTMENT OF TRANSPORTATION
CONDUIT DIVISION

ISSUED	REVISED	REVISED
8 / 2010		

PRECAST RECESSED EXTENSION

STANDARD NO.
BC 826.07-1

SCALE : NONE